

IKO PLC

Appley Lane North
Appley Bridge
Wigan
Lancashire WN6 9AB

Tel: 01257 256 864 Fax: 01257 252 514

e-mail: technical.uk@iko.com

website: www.ikogroup.co.uk



Agrément Certificate

95/3133

Product Sheet 1

IKO DAMP-PROOF COURSES

IKO HYLOAD ORIGINAL DAMP-PROOF COURSE

This Agrément Certificate Product Sheet⁽¹⁾ relates to IKO Hyload Original Damp-Proof Course, for use in providing horizontal, vertical or stepped damp-proof courses, including cavity trays, in either solid or cavity walls of brick, block, stone or concrete.

(1) Hereinafter referred to as 'Certificate'.

CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.



KEY FACTORS ASSESSED

Behaviour under load — the product will not extrude under load, up to the point of compressive failure of the wall (see section 6).

Resistance to water and water vapour — the product will provide an effective barrier against liquid water and water vapour (see section 7).

Compatibility with other materials — within normal construction, the product is compatible with all materials with which it will be in contact (see section 8).

Durability — when properly specified and installed, the product, in normal circumstances, will remain effective during the lifetime of the building (see section 10).



The BBA has awarded this Certificate to the company named above for the product described herein. This product has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Date of Seventh issue: 17 September 2019

John Albon
Chief Scientific Officer

Claire Curtis-Thomas
Chief Executive

Originally certificated on 7 September 1995

The BBA is a UKAS accredited certification body – Number 113.

*The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at www.bbacerts.co.uk
Readers are advised to check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA direct.*

Any photographs are for illustrative purposes only, do not constitute advice and should not be relied upon.

British Board of Agrément

Bucknalls Lane
Watford
Herts WD25 9BA

©2019

tel: 01923 665300
clientservices@bbacerts.co.uk
www.bbacerts.co.uk

Regulations

In the opinion of the BBA, IKO Hyload Original Damp-Proof Course, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements of the following Building Regulations (the presence of a UK map indicates that the subject is related to the Building Regulations in the region or regions of the UK depicted):



The Building Regulations 2010 (England and Wales) (as amended)

Requirement:	A1	Loading
Comment:		The product will not extrude under load, up to the point of compressive failure of the wall, and will not adversely affect the ability of a properly designed and built wall to sustain and transmit compression loads. See section 6.1 of this Certificate.
Requirement:	C2(a)(b)	Resistance to moisture
Comment:		When properly installed in a correctly designed structure, the product forms an effective barrier to the movement of water within the wall, enabling compliance with this Requirement. See section 7 of this Certificate.
Regulation:	7	Materials and workmanship (applicable to Wales only)
Regulation:	7(1)	Materials and workmanship (applicable to England only)
Comment:		The product is acceptable. See section 10 and the <i>Installation</i> part of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)	Durability, workmanship and fitness of materials
Comment:		The product can contribute to a construction satisfying this Regulation. See section 10 and the <i>Installation</i> part of this Certificate.
Regulation:	9	Building standards applicable to construction
Standard:	1.1(a)(b)	Structure
Comment:		The product will not extrude under load, up to the point of compressive failure of the wall, and will not adversely affect the ability of a properly designed and built wall to sustain and transmit compression loads, with reference to clauses 1.1.1 ⁽¹⁾⁽²⁾ and 1.1.3 ⁽¹⁾⁽²⁾ of this Standard. See section 6.1 of this Certificate.
Standard:	3.4	Moisture from the ground
Standard:	3.10	Precipitation
Comment:		When properly installed in a correctly designed structure, the product forms an effective barrier to the movement of water within the wall, enabling compliance with these Standards, with reference to clauses 3.4.1 ⁽¹⁾⁽²⁾ and 3.10.1 ⁽¹⁾⁽²⁾ . See section 7 of this Certificate.
Standard:	7.1(a)	Statement of sustainability
Comment:		The product can contribute to meeting the relevant requirements of Regulation 9, Standards 1 to 6 and therefore will contribute to a construction meeting a bronze level of sustainability as defined in this Standard.
Regulation:	12	Building standards applicable to conversions
Comment:		All comments given for the product under Regulation 9, Standards 1 to 6 also apply to this Regulation, with reference to clause 0.12.1 ⁽¹⁾⁽²⁾ and Schedule 6 ⁽¹⁾⁽²⁾ .

(1) Technical Handbook (Domestic).

(2) Technical Handbook (Non-Domestic).



The Building Regulations (Northern Ireland) 2012 (as amended)

Regulation:	23(a)(i)	Fitness of materials and workmanship
Comment:	(iii)(b)(i)	The product is acceptable. See section 10 and the <i>Installation</i> part of this Certificate.
Regulation:	28(a)(b)	Resistance to moisture and weather
Comment:		When properly installed in a correctly designed structure, the product forms an effective barrier to the movement of water within the wall, enabling compliance with this Regulation. See section 7 of this Certificate.
Regulation:	30	Stability
Comment:		The product will not extrude under load, up to the point of compressive failure of the wall, and will not adversely affect the ability of a properly designed and built wall to sustain and transmit compression loads. See section 6.1 of this Certificate.

Construction (Design and Management) Regulations 2015

Construction (Design and Management) Regulations (Northern Ireland) 2016

Information in this Certificate may assist the client, designer (including Principal Designer) and contractor (including Principal Contractor) to address their obligations under these Regulations.

See sections: 1 *Description* (1.2) and 3 *Delivery and site handling* (3.4) of this Certificate.

Additional Information

NHBC Standards 2019

In the opinion of the BBA, IKO Hyload Original Damp-Proof Course, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements in relation to *NHBC Standards*, Chapter 6.1 *External masonry walls*.

CE marking

The Certificate holder has taken the responsibility of CE marking the product in accordance with harmonised European Standard BS EN 14909 : 2012. An asterisk (*) appearing in this Certificate indicates that data shown are given in the manufacturer's Declaration of Performance.

Technical Specification

1 Description

1.1 IKO Hyload Original Damp-Proof Course is a flexible black sheet material with grained surfaces. It consists of a mixture of PVC, synthetic fibres and other additives.


1.2 The sheets are manufactured to the nominal characteristics given in Table 1.

Table 1 Nominal characteristics

Characteristic (unit)	Value
Thickness (mm)	1.25
Weight (kg·m ⁻²)	1.85
Roll length (m)	20
Roll width (mm)	75, 100, 112.5, 125, 150, 225, 300, 337.5, 360, 450, 600, 900 and 1000
Watertightness* (2 kPa)	Pass
Durability (artificial ageing)*	Pass
Durability (alkali)*	Pass
Resistance to low temperature* (°C)	-15
Resistance to impact* (mm)	500 (Aluminium)
Resistance to static loading* (kg)	20 (Concrete)

1.3 Hyload Preformed Cloak Units are made from a 1.5 mm polymer sheet and are preformed flexible units for complex or awkward junctions of the cavity tray. Typical examples are shown in Figure 1. Cloaks to other designs can be fabricated to order.

Figure 1 Hyload Preformed Cloak Units

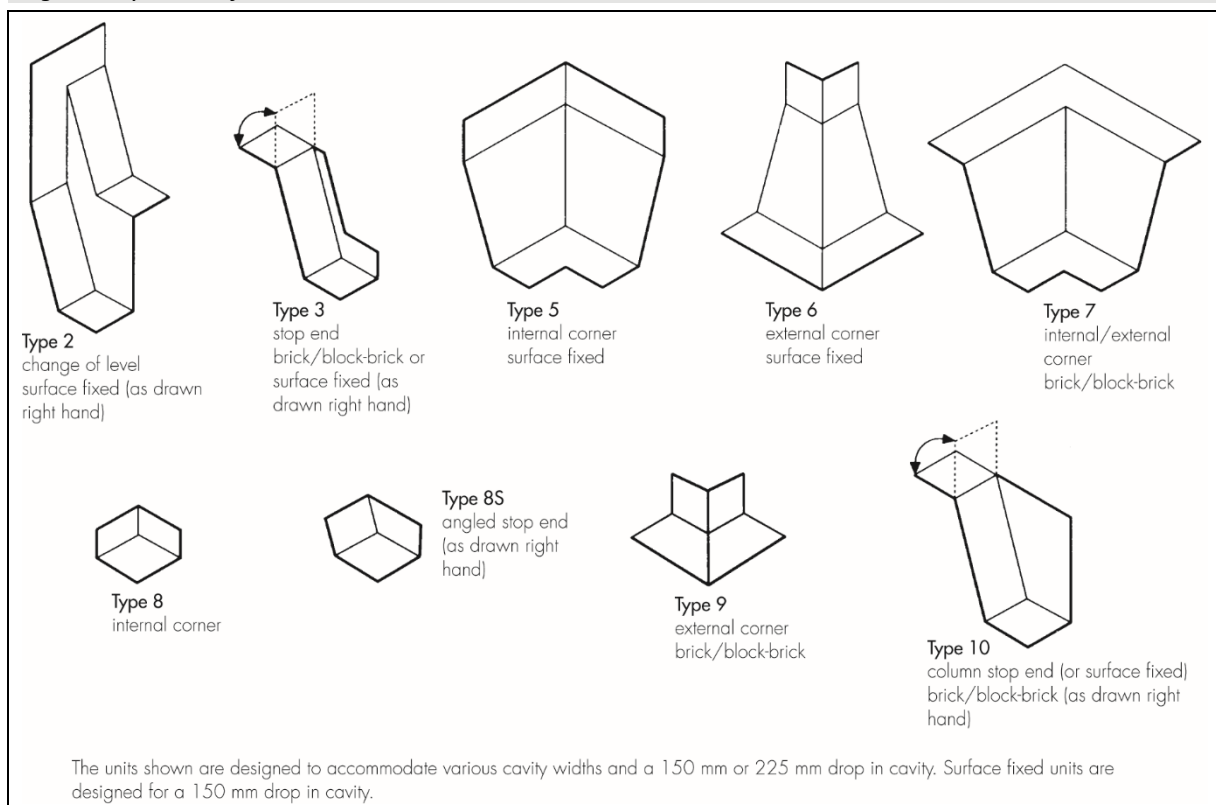

1.4 Hyload DPC Jointing Tape is a 100 mm wide self-adhesive tape, protected on both sides by silicone release paper.

1.5 IKOpro Self Adhesive Bitumen Primer is used where required on concrete, brickwork, blockwork and steel.

1.6 Hyload DPC Mastic is a thick, synthetic rubber mastic with gap-filling properties and is suitable for bonding Hyload to Hyload and to a range of common building materials.

1.7 Hyload DPC Fixing Strip is a semi-rigid plastic strip, 25 mm by 3 mm by 2 m, pre-drilled at 150 mm centres.

1.8 Hyload DPC Fixing Pins are for use with Hyload DPC Fixing Strip. Hyload DPC Fixing Pins for masonry are used for fixing to solid internal substrates such as blockwork, stone and concrete. Hyload DPC Fixing Pins for insulation are used for fixing to the rigid urethane foam insulation of lightweight framing systems.

2 Manufacture

2.1 The sheets are manufactured by compounding and calendering processes.

2.2 Hyload Preformed Cloak Units are preformed in the factory (see Figure 1).

2.3 As part of the assessment and ongoing surveillance of product quality, the BBA has:

- agreed with the manufacturer the quality control procedures and product testing to be undertaken
- assessed and agreed the quality control operated over batches of incoming materials
- monitored the production process and verified that it is in accordance with the documented process
- evaluated the process for management of nonconformities
- checked that equipment has been properly tested and calibrated
- undertaken to carry out the above measures on a regular basis through a surveillance process, to verify that the specifications and quality control operated by the manufacturer are being maintained.

2.4 The management system of IKO PLC has been assessed and registered as meeting the requirements of BS EN ISO 9001 : 2015 by BSI (Certificate Q05233).

3 Delivery and site handling

3.1 The damp-proof course (dpc) material is delivered in rolls secured with a paper wrapper bearing the Certificate holder's name and the BBA logo incorporating the number of this Certificate.

3.2 Rolls must be stored on end and under cover. Contact with organic solvents must be avoided.

3.3 Hyload Cavity Tray Units are delivered in cardboard boxes. A label bearing a description of the contents and the BBA logo incorporating the number of this Certificate is affixed to each box.

3.4 The Certificate holder has taken the responsibility of classifying and labelling the product under the *CLP Regulation (EC) No 1272/2008 on the classification, labelling and packaging of substances and mixtures*. Users must refer to the relevant Safety Data Sheet(s).

Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on IKO Hyload Original Damp-Proof Course.

Design Considerations

4 Use

4.1 IKO Hyload Original Damp-Proof Course and Hyload Preformed Cloak Units, when correctly specified and installed in accordance with this Certificate, provide satisfactory horizontal, vertical or stepped damp-proof coursing in either solid or cavity walls of brick, block, stone or concrete. General standards of good design practice are given in BS EN 1996-1-1 : 2005, BS EN 1996-1-2 : 2005, BS EN 1996-2 : 2006 and BS EN 1996-3 : 2006, and their UK National Annexes, and PD 6697 : 2010.

4.2 Hyload DPC Jointing Tape provides an effective method of joining IKO Hyload Original Damp-Proof Course to itself or to Hyload Preformed Cloak Units.

4.3 The products may be used separately or in combination.

5 Practicability of installation

Installation of the product is designed to be carried out by a bricklayer experienced with this type of product.

6 Behaviour under load



6.1 The product will not extrude under load, up to the point of compressive failure of the wall, and will not adversely affect the ability of a properly designed and built wall to sustain and transmit compression load.

6.2 The stability of a wall in respect of lateral loads must be checked in relation to the stresses permitted between the dpc and the mortar. A wall incorporating the product must be designed and built in accordance with BS EN 1996-1-1 : 2005.

6.3 The product will withstand movement of the wall, and is unlikely to be impaired by normally occurring movements up to the point where the wall itself is deemed to have failed.

6.4 The presence of a dpc can reduce the shear and tensile (and therefore, bending) strengths of a wall at that point and design of the structure should take account of this. Shear tests carried out to BS EN 1052-4 : 2000 gave characteristic shear strengths as detailed in Table 2 of this Certificate. The characteristic flexural strength as tested to DD 86-1 : 1983 is given as 0.13 N·mm⁻².

Table 2 Characteristic shear strength of IKO Hyload Original Damp-Proof Course

Pre-compression (N·mm ⁻²)	Characteristic shear strength (N·mm ⁻²)
0.2	0.14
0.6	0.26
1.0	0.44

7 Resistance to water and water vapour



When correctly specified and installed, the product will provide an effective barrier against liquid water and water vapour, either from a source external to the structure, or from one part of the structure to another.

8 Compatibility with other materials

The product is compatible with all materials with which it will be in contact within normal construction. It is unaffected by timber preservatives or water-based solutions of salts. Where doubt exists as to the compatibility of materials in contact, the advice of the Certificate holder must be sought.

9 Maintenance

As the product is confined within the structure and has satisfactory durability (see section 10), maintenance is not required. However, any damage occurring before enclosure must be repaired (see section 16).

10 Durability



When properly specified and installed, the product, in normal circumstances, will remain effective for the lifetime of the building.

11 General

11.1 Installation of IKO Hyload Original Damp-Proof Course must follow normal good practice for the detailing of damp-proof courses, as set out in PD 6697 : 2010, and be in accordance with the relevant clauses of BS 8000-0 : 2014, BS 8000-3 : 2001, BS 8215 : 1991, BRE Digest 380, and the Certificate holder's instructions.

11.2 As with all flexible damp-proof courses, care should be taken to avoid impact damage from sharp objects (eg trowels) during installation.

12 Handling

12.1 IKO Hyload Original Damp-Proof Course is handled and cut as for conventional flexible damp-proof courses. It retains sufficient flexibility to be used at the lowest temperature at which walls are normally built and does not become tacky in warm, ambient weather conditions.

12.2 Certain details are difficult to form from the dpc, particularly when bending material through two angles at the same time. In such cases, care must be taken to achieve a satisfactory seal and, where necessary, Hyload Preformed Cloak Units should be used. Joints should be formed on site using Hyload DPC Jointing Tape. Care should be taken at temperatures below 5°C to avoid the risk of condensation on jointed surfaces which may affect the efficiency of the self-adhesive tape.

13 Installation practice

13.1 The following installation practices are essential:

- the dpc must extend through the full thickness of the wall or wall-leaf, including pointing, applied rendering or other facing material
- the dpc must be laid on a wet, even bed of mortar (perforations in adjacent courses of brickwork must be closed with mortar) and be laid flush or project beyond the finished face of the external leaf
- the dpc must always be sandwiched between wet mortar and not laid dry
- all lap joints in the dpc must have at least a 100 mm overlap and be completely sealed (see section 14) and supported in accordance with the Certificate holder's instructions
- Hyload Preformed Cloak Units must be used at complex or awkward junctions of the cavity tray, for example at corners or changes in level of the cavity tray
- where used as a cavity tray, the dpc laps must be sealed.

13.2 When using IKO Hyload Original Damp-Proof Course with boot lintels or similar constructions, it is recommended that the material is installed to follow the lintel profile, where appropriate.

14 Jointing procedure

14.1 Lap joints must be bonded using Hyload DPC Jointing Tape applied to one surface (the silicone tapes having been removed immediately beforehand) and even pressure applied to the joint.

14.2 All surfaces to be jointed must be clean and dry. Release paper protecting the self-adhesive strips should not be removed until the joint is ready to be formed. The tape should not be left exposed overnight or during periods of low temperature.

14.3 Where the dpc cavity tray or Hyload Preformed Cloak Unit is required to be bonded to a brick, block or concrete substrate (surfaced fixed), it can be held in place by Hyload DPC Jointing Tape bonded to the substrate, which must be primed with IKOpro Self Adhesive Bitumen Primer. A permanent mechanical fixing should then be installed using Hyload DPC Fixing Strip and Hyload DPC Fixing Pins for masonry. Where surface fixing to the ridged urethane foam insulation of lightweight framing systems, Hyload DPC Jointing Tape, Hyload DPC Fixing Strip and Hyload DPC Fixing Pins for insulation should be used.

15 Cleaning cavities

As with most other dpc materials, damage can occur during cleaning of mortar droppings from the dpc unless care is taken. Recommendations to prevent damage are:

- the use of cavity battens to prevent excessive amounts of mortar reaching the dpc
- removal of mortar droppings before hardening
- that implements such as steel rods are not used for cleaning
- that damp-proof courses are regularly inspected for damage as work proceeds.

16 Repair

Damaged areas of the dpc can be repaired prior to installation by cutting and/or replacing the damaged section, ensuring joints are made in accordance with section 14. Once covered, the product cannot be repaired.

Technical Investigations

17 Tests

17.1 Tests were conducted on the product and the results assessed to determine:

- water vapour permeability
- water vapour resistance
- water absorption
- cold temperature flexibility
- dimensions
- tensile strength and elongation
- handling characteristics
- tear strength
- effects of ageing
- resistance to compression at high temperatures
- resistance to water transmission under pressure
- resistance to puncturing and splitting under simulated service conditions.

17.2 Tests were conducted on Hyload Preformed Cloak Units and the results assessed to determine:

- tensile strength/elongation of sheets and welds
- joint strength
- tear strength of sheets and welds
- low temperature flexibility of sheets and welds.

18 Investigations

18.1 The manufacturing process was evaluated, including the methods adopted for quality control, and details were obtained of the quality and composition of the materials used.

18.2 A user survey was conducted to evaluate performance in use.

18.3 An evaluation was made of reports on shear and flexure tests.

Bibliography

BRE Digest 380 *Damp-proof courses*

BS 8000-0 : 2014 *Workmanship on building sites — Code of practice for below ground drainage*

BS 8000-3 : 2001 *Workmanship on building sites — Code of practice for masonry*

BS 8215 : 1991 *Code of practice for design and installation of damp-proof courses in masonry construction*

BS EN 1052-4 : 2000 *Methods of test for masonry — Determination of shear strength including damp proof course*

BS EN 1996-1-1 : 2005 + A1 : 2012 *Eurocode 6: Design of masonry structures — General rules for reinforced and unreinforced masonry structures*

NA to BS EN 1996-1-1 : 2005 + A1 : 2012 UK National Annex to *Eurocode 6: Design of masonry structures — General rules for reinforced and unreinforced masonry structures*

BS EN 1996-1-2 : 2005 *Eurocode 6: Design of masonry structures — General rules — Structural fire design*

NA to BS EN 1996-1-2 : 2005 UK National Annex to *Eurocode 6: Design of masonry structures — General rules — Structural fire design*

BS EN 1996-2 : 2006 *Eurocode 6: Design of masonry structures — Design considerations, selection of materials and execution of masonry*

NA to BS EN 1996-2 : 2006 UK National Annex to *Eurocode 6: Design of masonry structures — Design considerations, selection of materials and execution of masonry*

BS EN 1996-3 : 2006 *Eurocode 6: Design of masonry structures — Simplified calculation methods for unreinforced masonry structures*

NA to BS EN 1996-3 : 2006 UK National Annex to *Eurocode 6: Design of masonry structures — Simplified calculation methods for unreinforced masonry structures*

BS EN 14909 : 2012 *Flexible sheets for waterproofing — Plastic and rubber damp proof courses — Definitions and characteristics*

BS EN ISO 9001 : 2015 *Quality management systems — Requirements*

DD 86-1 : 1983 *Damp-proof courses — Methods of tests for flexural bond strength and short term shear strength*

PD 6697 : 2010 *Recommendations for the design of masonry structures to BS EN 1996-1-1 and BS EN 1996-2*

19 Conditions

19.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page – no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- is valid only within the UK
- has to be read, considered and used as a whole document – it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English Law.

19.2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

19.3 This Certificate will remain valid for an unlimited period provided that the product/system and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

19.4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

19.5 In issuing this Certificate the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- actual installations of the product/system, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product/system is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product/system, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to CE marking.

19.6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.